

VARIABLES

VAR_GLOBAL

(* Logic I/O *)

Do000CPU AT %QX255.0 : BOOL; (* Output 00 CPU module *)

(* HMI *)

SetOffTime AT %MD100.2048 : UDINT; (* Set Off time (mS) *)

SetOnTime AT %MD100.2052 : UDINT; (* Set On time (mS) *)

RealOffTime AT %MD100.0 : UDINT; (* Real Off time (mS) *)


RealOnTime AT %MD100.4 : UDINT; (* Real On time (mS) *)

HMILamp AT %MX100.16 : BOOL; (* Lamp on HMI *)

END_VAR

	Project : HMITimer	
	VARIABLES :	
	Release : HMITimer	Ver :1.00
	Author :	Date:23/05/2013
	Note :	Page:1 of 1

```
VAR
TOff : eTON; (* Timer Off *)
TOn  : eTON; (* Timer On *)
END_VAR
```

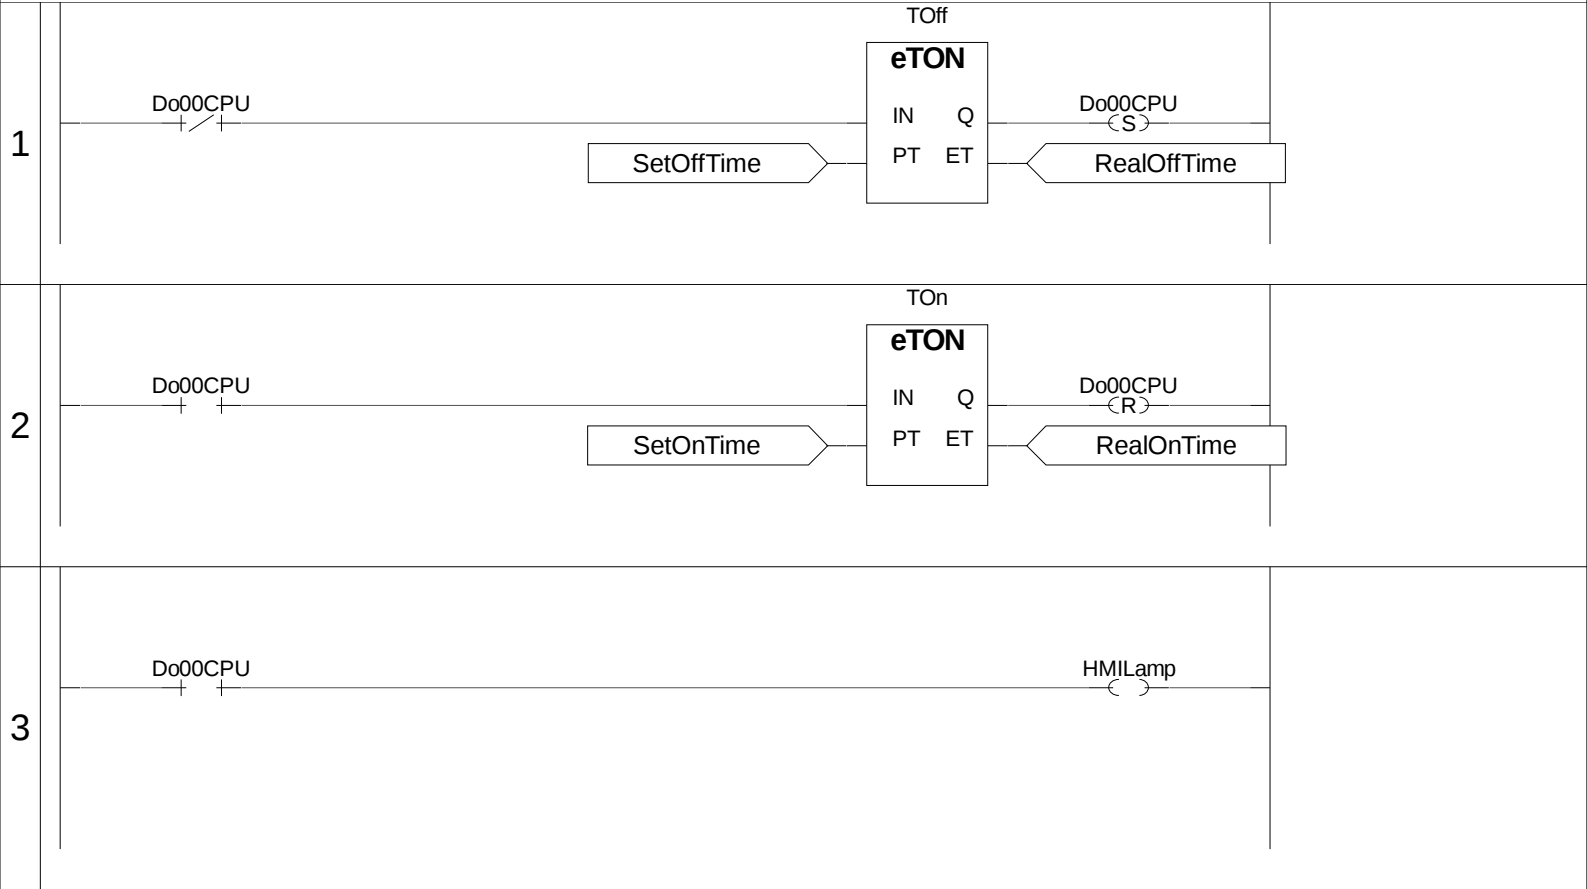

	Project : HMITimer	
	PROGRAM : LD	
	Release : HMITimer	Ver :1.00
	Author :	Date:23/05/2013
	Note :	Page:1 of 1